

DEPARTMENT OF THE NAVY

Memorandum


DATE: 26 Apr 79

FROM Director, Natural Resources and Environmental Affairs Division

TO MEMO FOR THE RECORD

SUBJ Field Inspections

1. As per LtCol Baisley's instructions Donald Clark and Andrew Luke inspected the field messhall wastewater drainage pits near Bldg M-320 and M-324 and concluded that no surface discharges were occurring.
2. I advised LtCol Baisley and LtCol Huckaby AC/S Facilities that no evidence of surface discharge was detected. I also advised that as far as could be determined at this point they were acceptable.
3. Size 5' deep x 10' x 10' (1 ea)
5' deep x 5' x 5'



JULIAN I. WOOTEN

1954

...

...

(as of 1954)

...

Base Maintenance Officer

Assistant Chief of Staff, Facilities

Dining Facility Drainage Pit; request for


- Ref: (a) FoneCon btwn Mr. Holdaway, EPA, and Mr. Wooten, BMaintDept, on 5 Apr 79
(b) HqSvcBn msg 301811Z Mar 79
(c) On site inspection and test by Mr. Rouse, Public Works Dept, and Mr. Black, BMaintDept, on 12 Apr 79

1. During reference (a) it was learned that the NPDES permit prohibits the surface discharge of wastewater described in reference (b). As discussed in reference (a), Mr. Holdaway stated the pit could be used if soil conditions would allow percolation. However, he recommended the wash water be containerized and transported to a sewage treatment plant for disposal.

2. Inspections and percolation tests conducted during reference (c) indicate a spodic horizon (hard pan) which prevents percolation.

3. Based on requirements in reference (a) and test results in reference (c), it is recommended the request to build subject pit be denied.

B. W. ELSTON
Acting

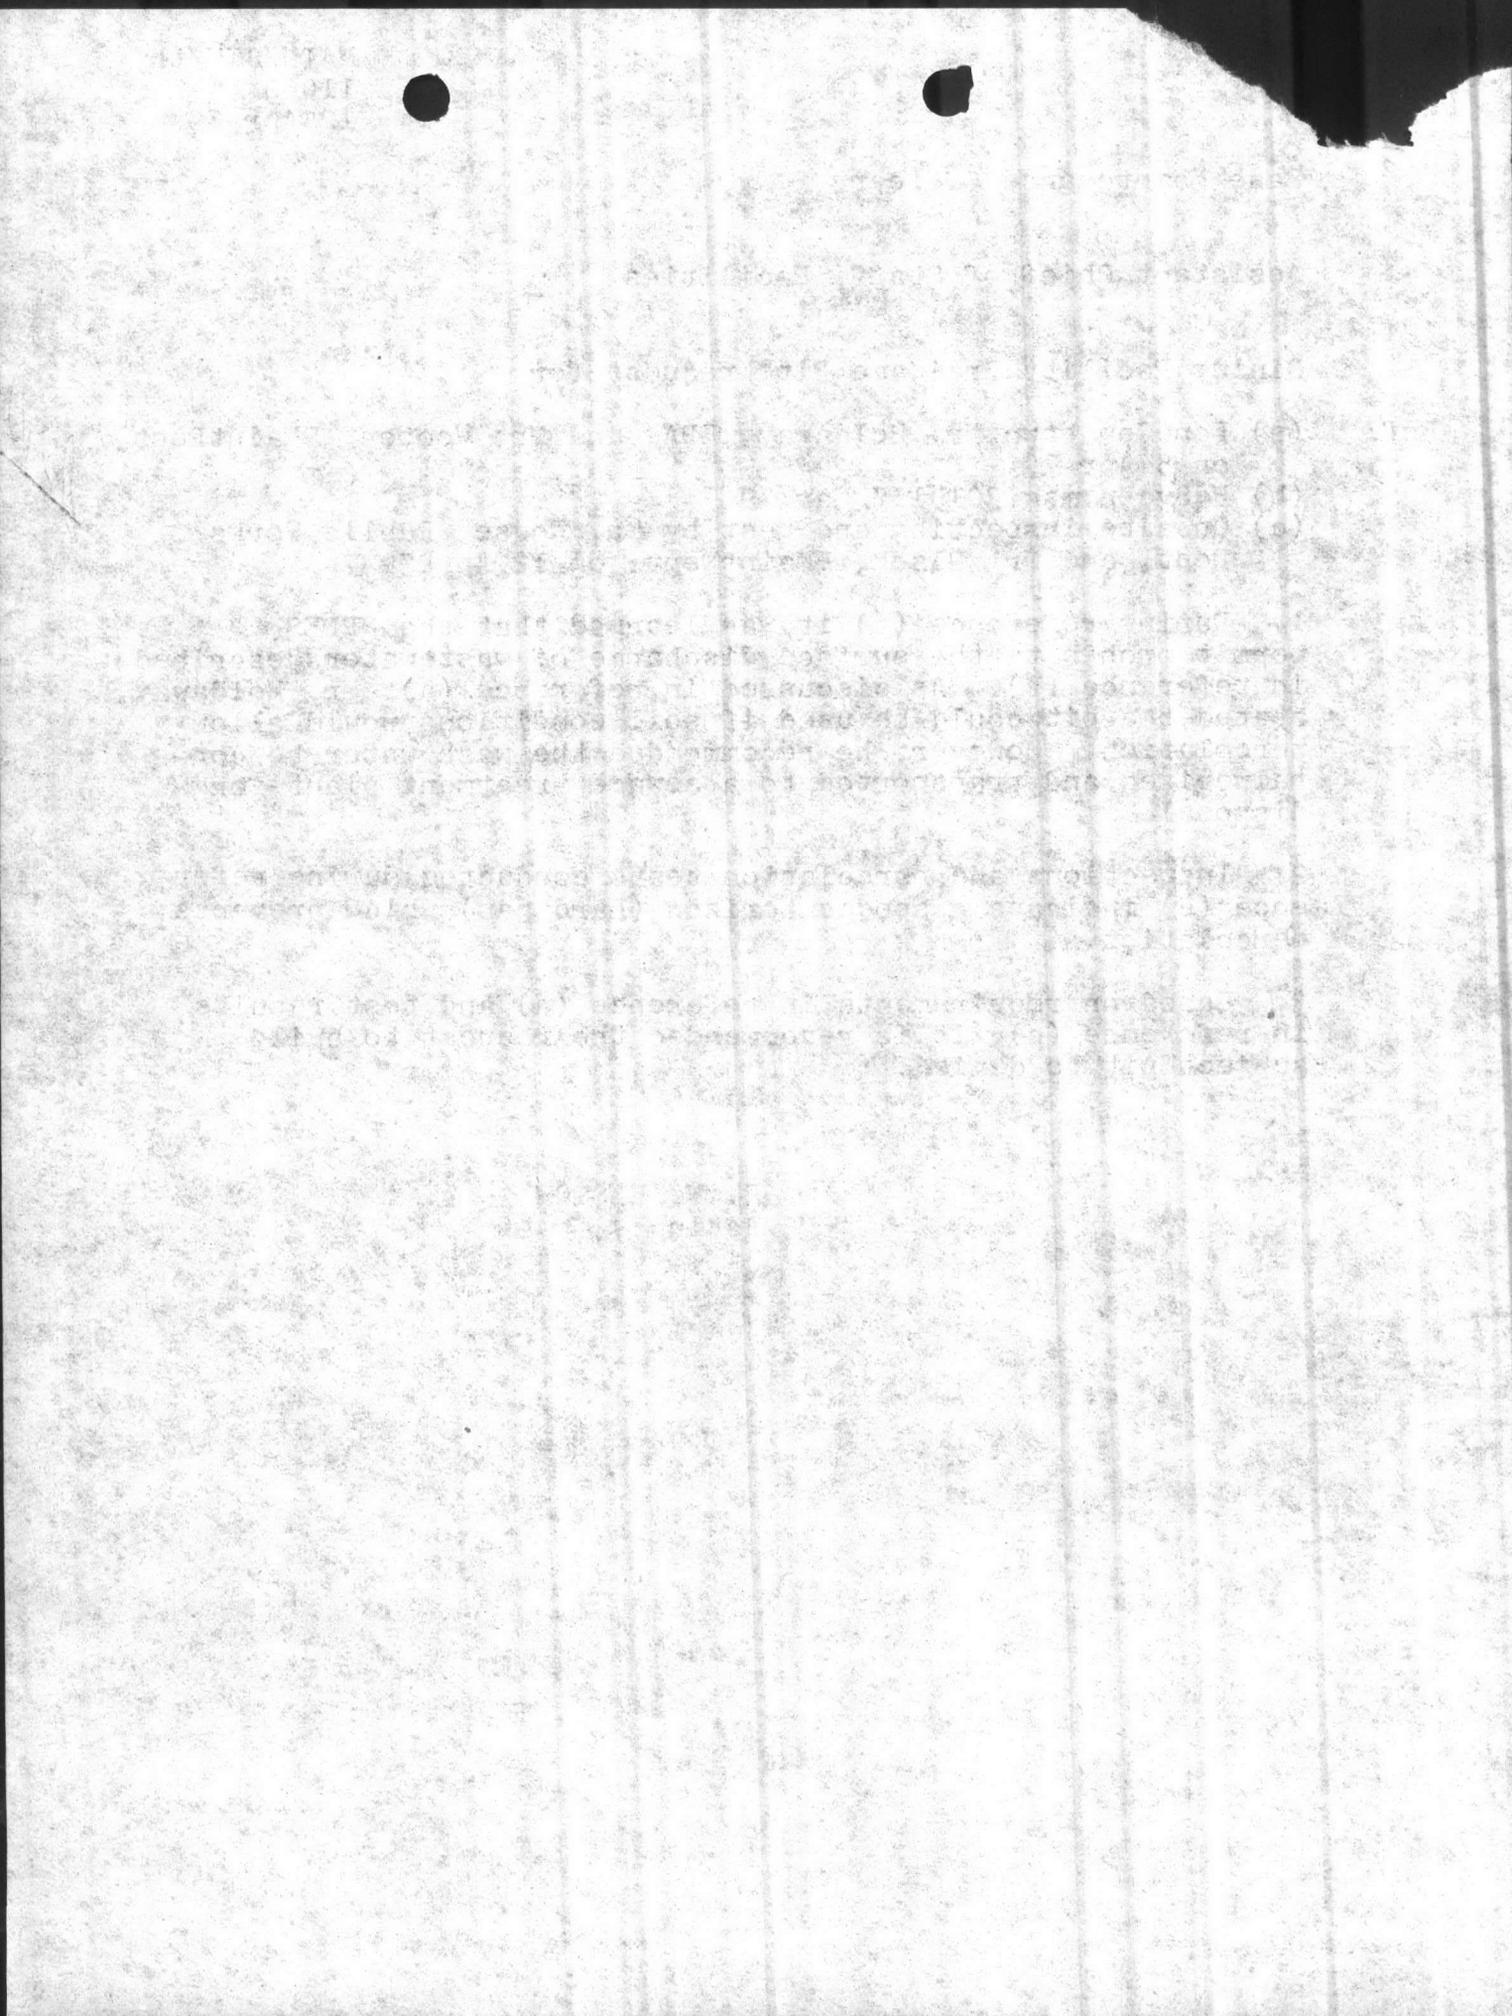

2880

C/S

VZCZCRBA046

PTTUZYUW RULSSGG5086 0891811-UUUU--RUCLBRA MAR 30 '79 58Z79

ZNR UUUUU

P 301811Z MAR 79

FM HQSVCBN FMFLANT

TO RUCLBRA/CG MCB CAMP LEJEUNE NC

INFO ZEN/CG FMFLANT

BT

PRIORITY

UNCLAS //N04000//

DINING FACILITY LOC SOLID SHIELD 79 (SS-79)

1. IN PREP OF THE SITE FOR THE II MAF CP FOR SS-79, IT IS THIS COMDS DESIRE TO LOCATE THE DINING FACILITY WITHIN COMBAT TOWN BETWEEN PINE STREET AND THE TANK TRAIL ADJACENT TO ELDG NO.9.

2. A PROBLEM ARISES IN THE LOC OF A POT AND PAN WASHING FACILITY FOR THE DINING FACILITY. IN ORDER TO WASH POTS AND PANS A METHOD OF DISPOSING OF THE WASH WATER MUST BE DEVISED THAT WILL COMPLY WITH ENVIRONMENTAL RESTR FOR THE AREA. IN ORDER TO REDUCE THE USE OF WATER FOR WASHING FOOD SERVICE EQUIP, THIS COMD HAS PLANNED TO DO ALL FOOD SERVING ON PAPER PRODUCTS DURING THE EX EXCEPT WHEN MCI'S ARE USED.

3. REQ AUTH TO CONSTRUCT DRAINAGE PIT OF SUF SIZE NEAR THE PROPOSED DINING FACILITY LOC TO HANDLE APRX 400 GAL OF WATER PER DAY. POC THIS COMD MAJ R. T. KOHL, AVN 690-6855/6228.

PAGE 02 RULSSGG5086 UNCLAS

4. ADD, REQ COPIES BASE RNG ORDERS/REGS BE FWD THIS COMD ATT S-4.

BT

#5086

TOR: 302058z MAR 79/22

ACT: SUPS

INFO: BMAT,FSMAO-1

*Tim
Facilities*

NNNN

30 1811Z MAR 79

